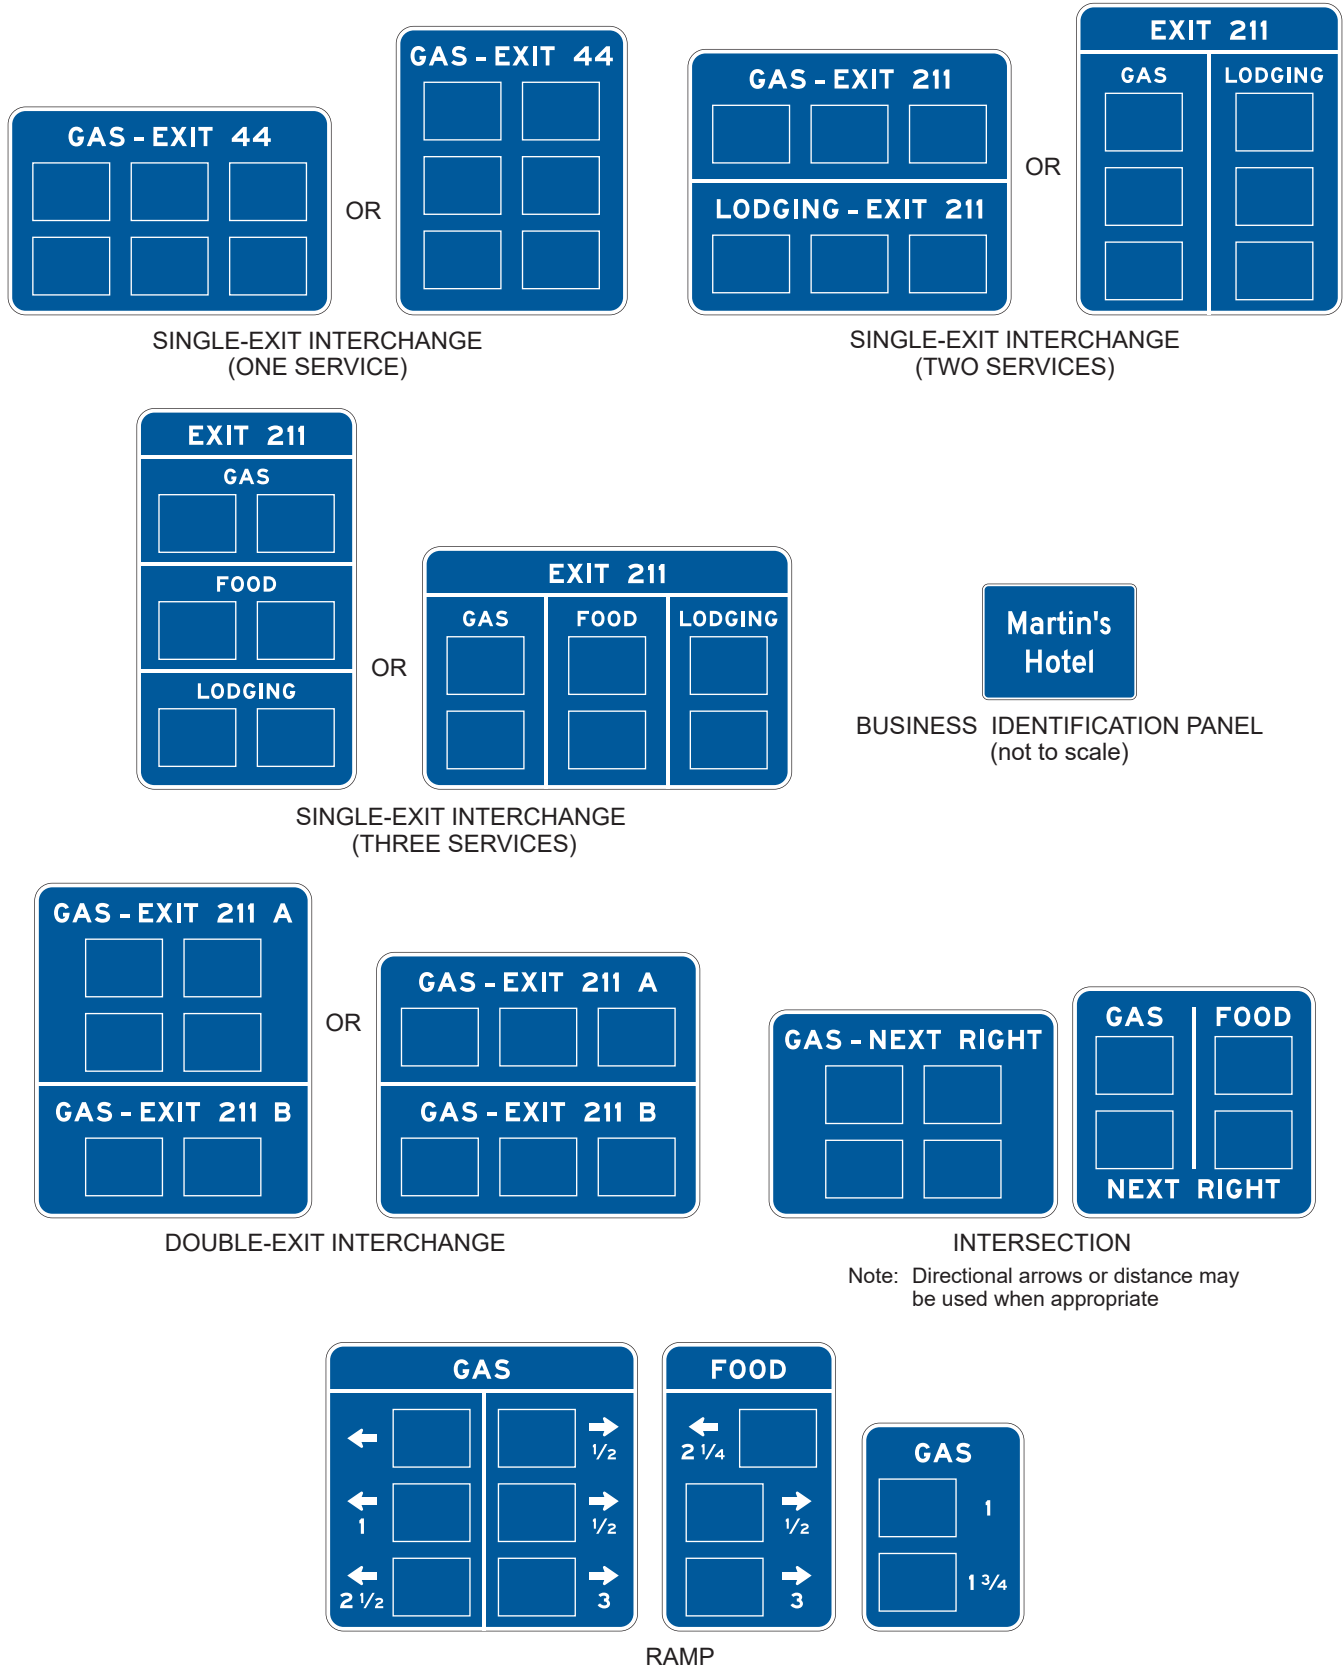


Figure 2J-1. Examples of Business Identification Panel Arrangements on Specific Service Signs



***Figure 2J-1(CA). California Examples of Business Identification
Panel Arrangements on Specific Service Signs***


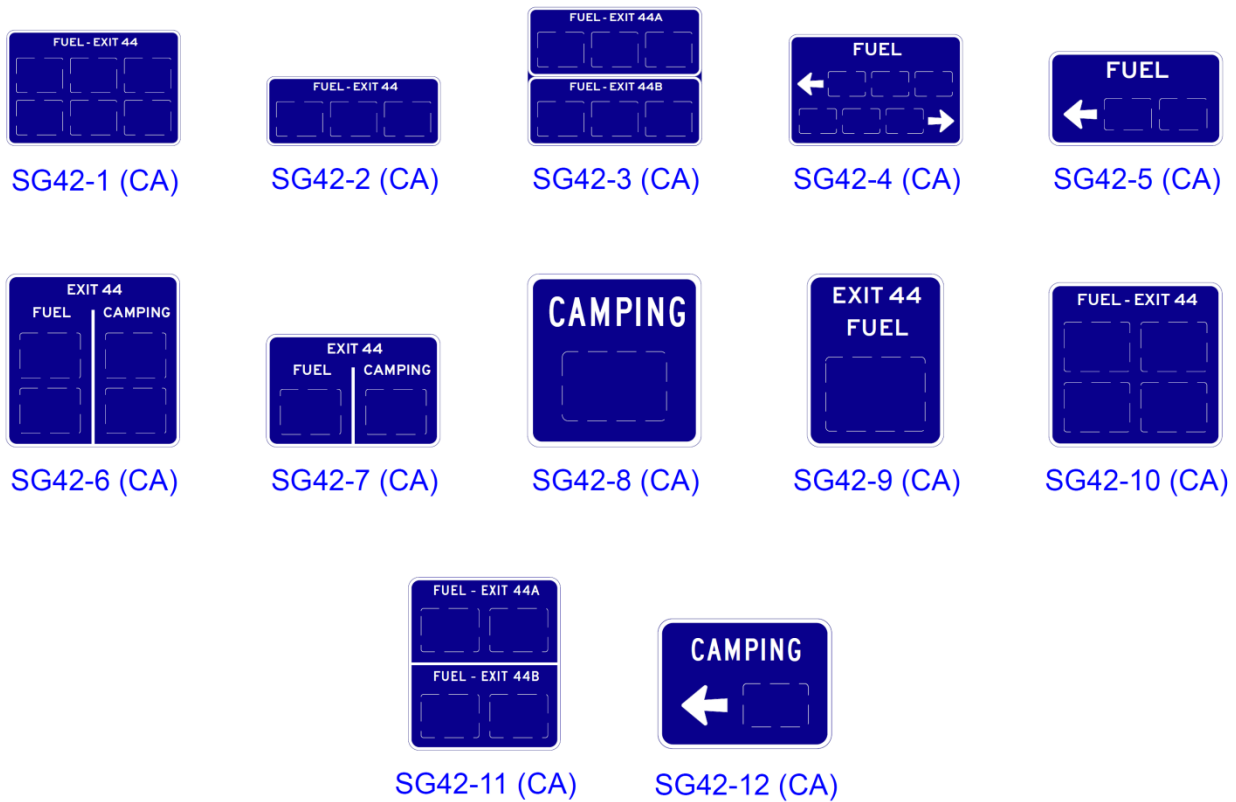


Figure 2J-2. Examples of Specific Service Sign Locations

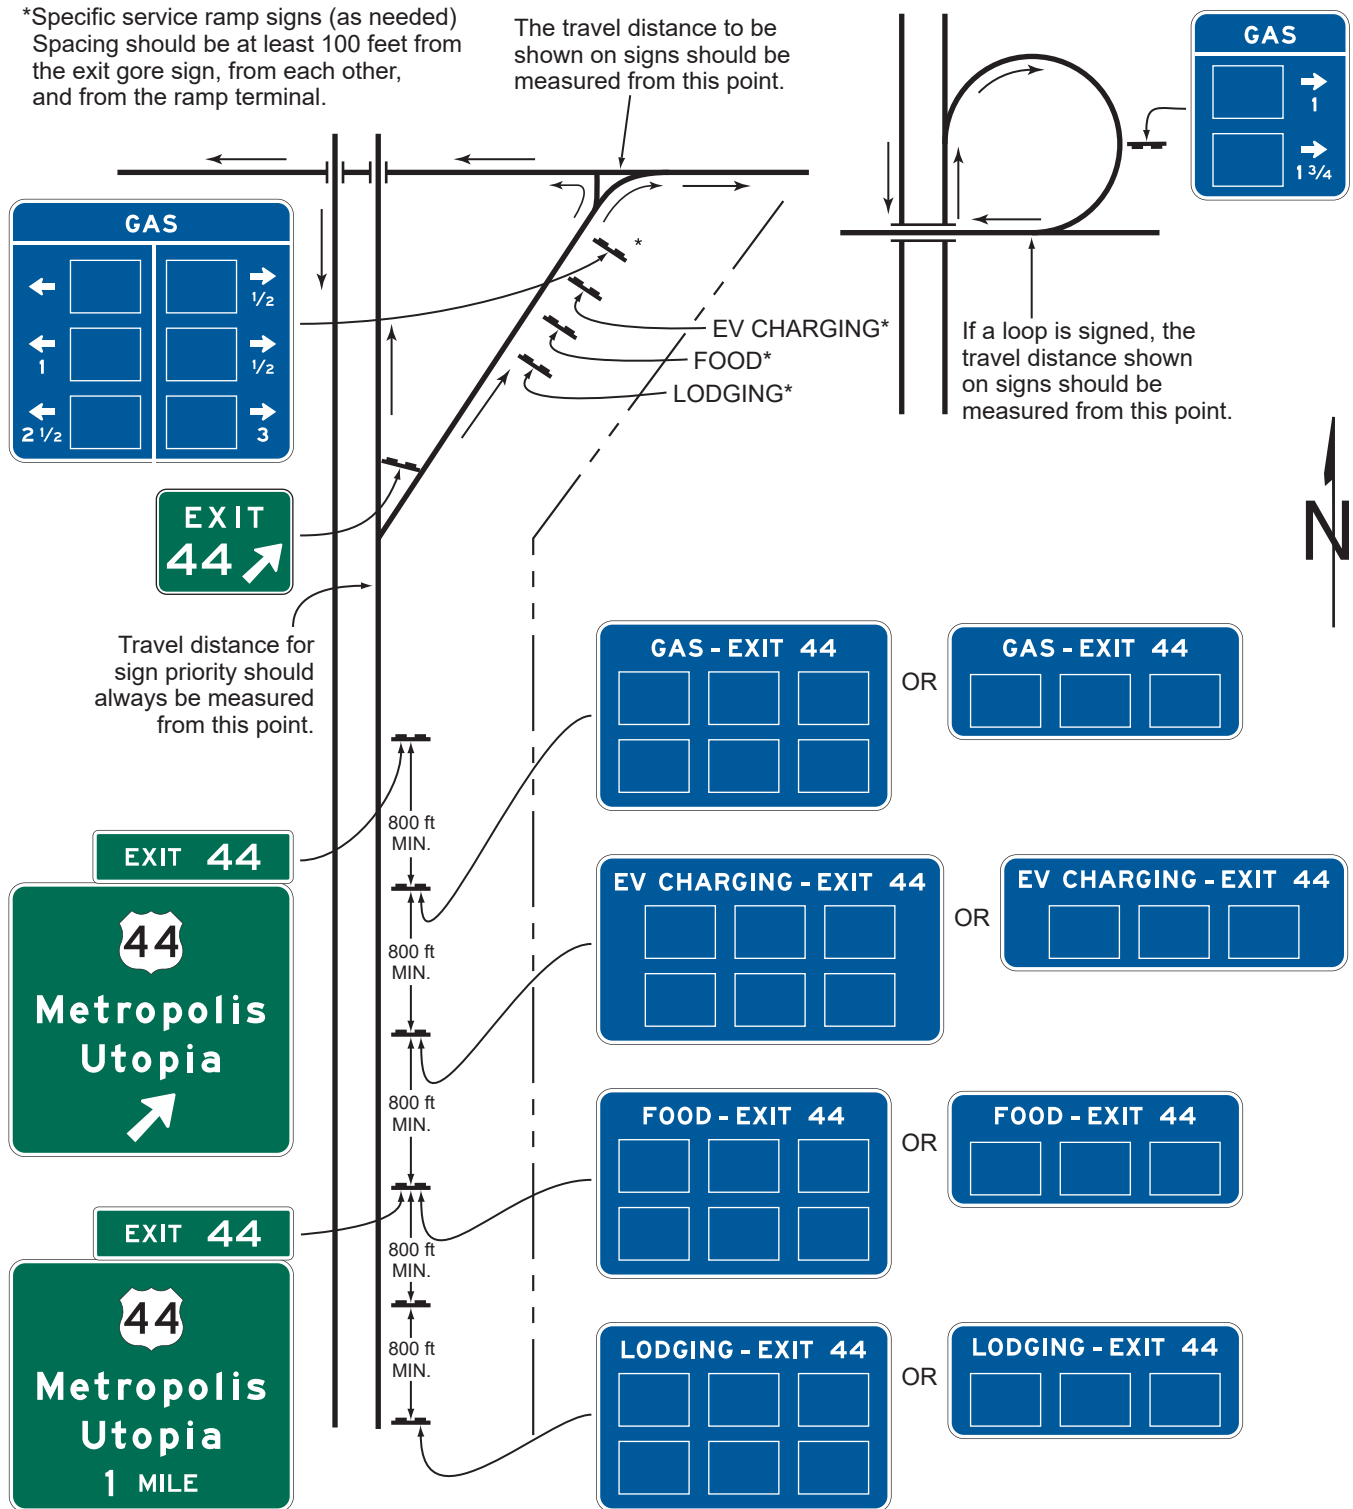

Note: If specific service ramp signs are used, their spacing should be at least 100 feet from the exit gore sign, from each other, and from the ramp terminal.

Figure 2J-4. Examples of Supplemental Messages on Business Identification Sign Panels

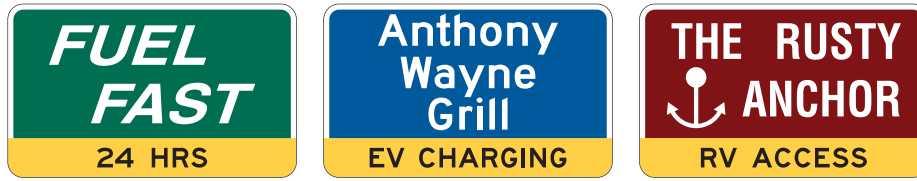




Figure 2J-6. Example of Signing for Services Accessed from a Collector-Distributor Road Adjacent to a Freeway

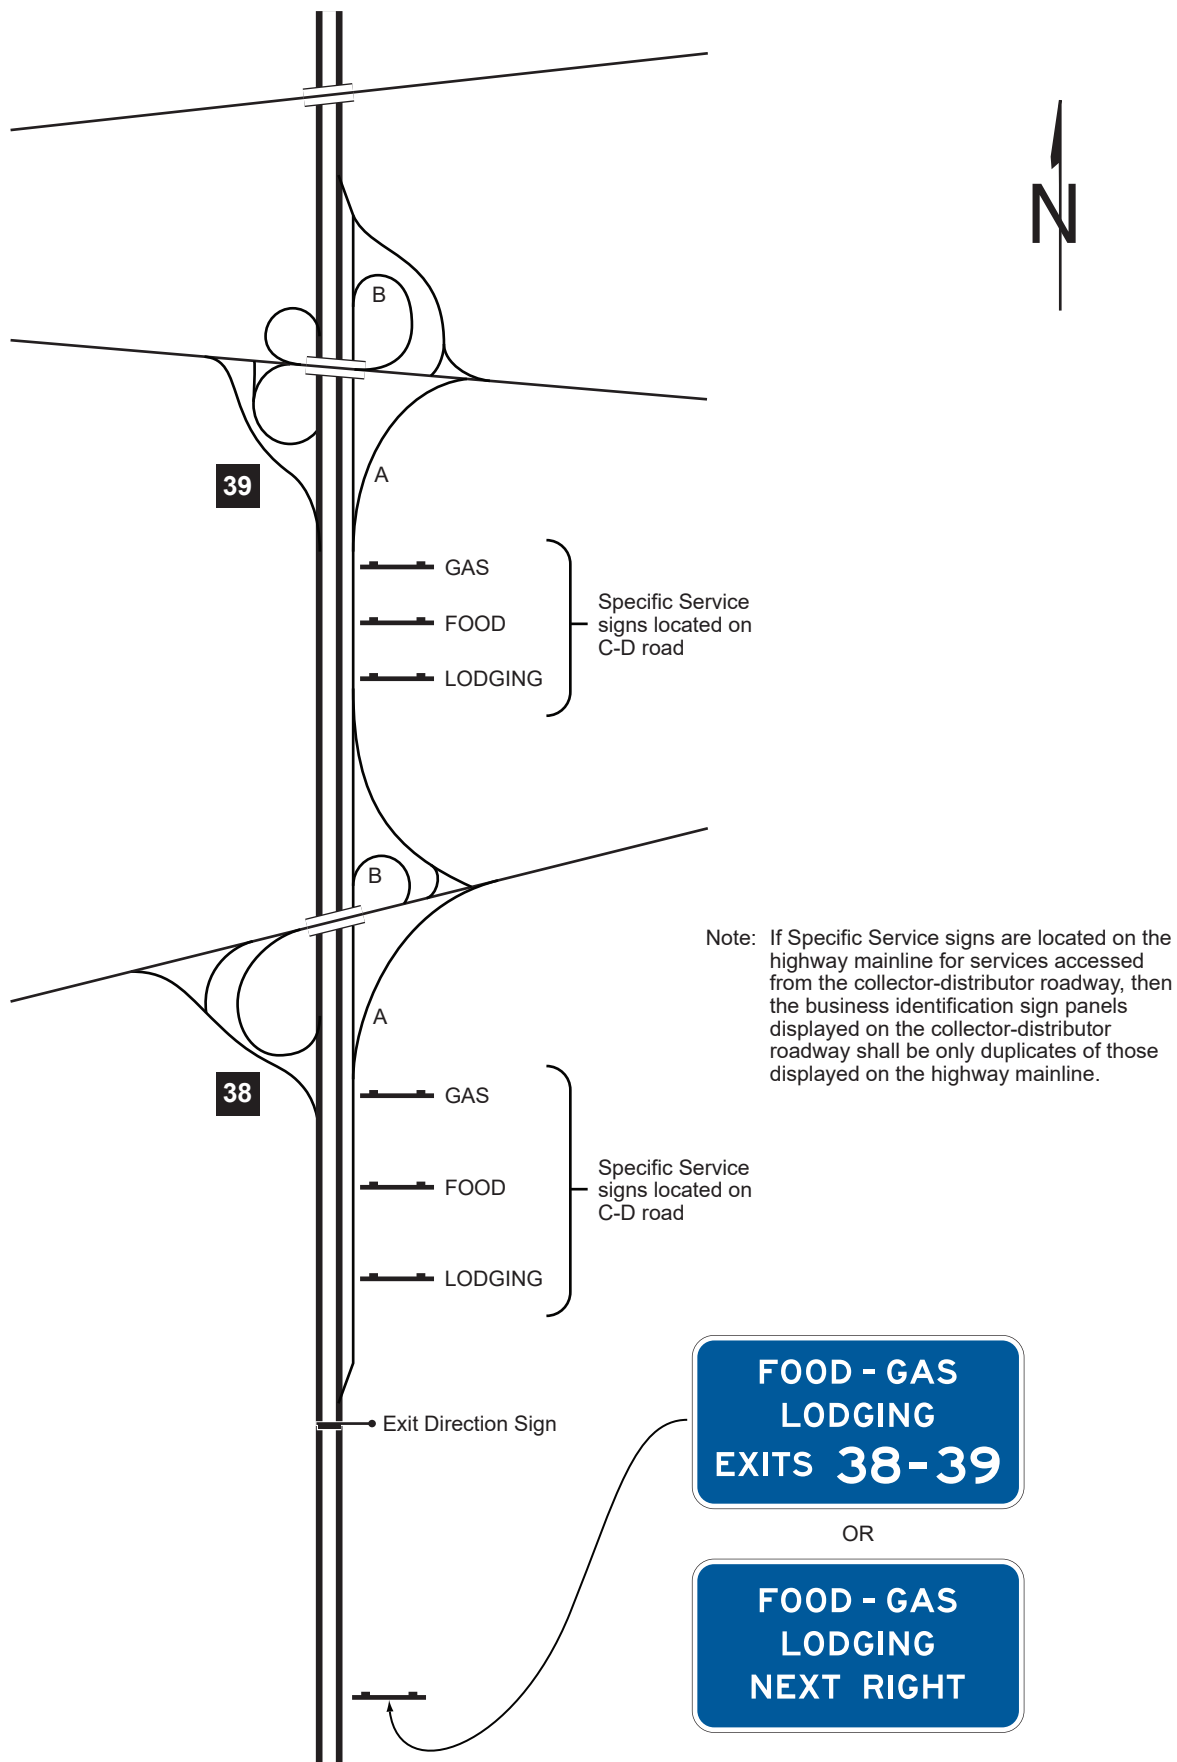


Figure 2J-7. Examples of Specific Service Trailblazer Signs

